

Experiences with an Experimental Project in A Graduate Control Course

Edward P. Gatzke, Rajanikanth Vadigepalli, Edward S. Meadows, Francis J. Doyle III*

Department of Chemical Engineering

University of Delaware

Newark, DE 19716

Abstract

This paper describes use of a laboratory experiment at the University of Delaware as part of a graduate level process control class. The experiment is a four tank system that exhibits multivariable interactions and rich dynamic behavior, providing many additional opportunities for future projects. In a graduate level class, University of Delaware students explored issues in system identification and robust control design. Key issues covered in the course such as multivariable interactions, control limitations, and model uncertainty were readily demonstrated using the experimental laboratory apparatus. The configuration incorporates a process control system commonly encountered in industrial applications.

Keywords: Graduate Course, Process Control, Experimental Apparatus

1 Introduction

A graduate level class on process control traditionally employs a standard lecture style course, possibly coupled with an independent course project carried out in a simulation environment. If one steps back to critique this approach, it is important to first address the skills required by a practicing process systems engineer. As a guide to the requisite abilities required of a process system engineer, one may consult the list of control design steps provided by Skogestad and Postlethwaite [4] shown in Table 1. Is the typical engineering graduate well-prepared to accomplish these tasks? There have been no comprehensive studies to answer this question, but Kheir *et al.* [3] reported the results of an informal survey of industrial employers of control engineers. The highest rated aspects of the current methods of control education

*Author to whom correspondence should be addressed: fdoyle@udel.edu

were *control system knowledge*, *job preparation*, and *curriculum*. The *analytical skills* of the students were considered strong. Such responses seem to indicate some success for items 7 through 9 of Skogestad's list of control design steps, areas which correspond to skills typically emphasized by a theoretical, textbook-and-lecture control courses.

Unfortunately, existing approaches to control engineering education are not necessarily producing engineers who are as knowledgeable in other areas. The Kheir survey respondents reported that control engineers received lower ratings in the areas of: *laboratories*, *hands-on experience*, and *interpersonal skills*. The course described in this paper uses both a standard lecture class and an experimental group project related to the course material. This provides the opportunity to address the deficiencies identified by Kheir and colleagues, while reinforcing the positive aspects of traditional control engineering education methods.

2 Course Description

The course described in this paper is Chemical Engineering 801 - Advanced Process Control. In the latest offering at the University of Delaware (Fall 1998), there were seven students enrolled for a grade and five students auditing the class. Of the seven students taking the class for a grade, five were University of Delaware graduate students and two were industrial professionals enrolled for continuing education credit.

As a main reference, the course used the text by Skogestad and Postlethwaite [4], and the major topics covered in the course include:

- Classical Multivariable Control
- Analysis of Performance Limitations
- Uncertainty Characterization
- Robust Control Synthesis
- Control Structure Selection and Plant-Wide Control

One of the key strengths of the Skogestad and Postlethwaite text is the treatment of performance limitations, and this topic was covered in depth in the lecture and reinforced via the experimental project. The course project was assigned in the middle of the semester, and the students were given the choice of a theoretical independent course project (related to their thesis research) or the opportunity to work on the experimental system as a group project. Of the five on-site students, four elected to carry out their project using the experimental Four Tank System.

3 Experimental System

An interacting four-tank process has been implemented at the University of Delaware. This process is currently used in both the elective multidisciplinary undergraduate control laboratory and the advanced graduate control course. The design is inspired by the benchtop apparatus described in [2]. A simple schematic is shown in Figure 1. Two voltage-controlled pumps are used to pump water from a basin into four overhead tanks. The two upper tanks drain freely into the two bottom tanks, and the two bottom tanks drain freely into the reservoir basin. The liquid levels in the bottom two tanks are directly measured with pressure transducers, and the top tanks have high level alarm signals generated by electro-optical sensors. As can be seen from the schematic, the piping system is configured such that each pump affects the liquid levels of both measured tanks. A portion of the flow from one pump flows directly into one of the lower level tanks where the level is monitored. The rest of the flow from a single pump is diverted into an overhead tank, which drains into the other monitored tank. By adjusting the bypass valves on the system, the amount of interaction between the two pump flowrates (inputs) and the two lower tank level heights (outputs) can be varied. For this work, it is assumed that an external unmeasured disturbance flow may also be present which drains or fills the top tanks.

The original work of [2] employed tanks with volume of $0.5L$. The present work uses $19L$ (5 gallon) tanks, attempting to create a visual impression of practical reality for the students. The scale of the apparatus is indicated in the photograph in Figure 2. In the lower right corner of that picture, one can see the display of a computer control system used as an interface to the experiment. A Bailey Freelance Distributed Control System (DCS) was employed to introduce the students to actual operating software employed in industry. Furthermore, the PC-based architecture made the system cost-effective for a University application and facilitates hardware and software upgrade paths.

The experimental package consists of 3 separate components, as shown in in Figure 3:

1. Experimental Station: tanks, level sensors, level alarms, valves, and pumps
2. Process Station: hardware that carries out the control input-output and communicates between the Experimental Station and the Operator Station
3. Operator Station: PC based system where Process Station information is monitored and modified

The Process Station communicates with the Operator Station over a private TCP/IP network. The Freelance application package DigiTool was used to create a process database which is loaded onto the Process Station. The DigiVis application allows operator interaction with the Process Station and process database. Operator displays were created that allowed the students to operate the Four Tank System (Figure 4) as well as track the trends of key operating variables (Figure 5).

For the graduate control class it is necessary to use more complex control algorithms than can be easily implemented using the Freelance packages. Matlab/Simulink can be used to calculate the control

moves needed for the experimental system. A Dynamic Data Exchange (DDE) interface is used to link Matlab/Simulink with Freelance. The Simulink display (Figure 6) emulates a standard simulation flowsheet. By default, the Bailey DCS controls the process using manual or PID control. However, once the student has “toggled” control (to Matlab from Bailey), the Simulink “simulation” drives the inputs to the Bailey system as the simulation proceeds. This creates a very flexible environment for implementing complex control algorithms on a moderately complex experimental system.

4 Mathematical Description of the Process

Both a nonlinear model and a linearized model are given in [2] for the Four Tank System. The models used for this work include the disturbance effects of flows in or out of tanks three and four. The nonlinear differential equations governing the heights in this four tank system are given in Table 2, and the linearized version is seen in Table 3. The liquid levels in tanks one and two, h_1 and h_2 , are considered measured variables. The speed of the pumps, ν_1 and ν_2 , are considered as manipulated inputs. The pump speeds are manipulated as a percentage of the maximum pump speed. The disturbances d_1 and d_2 model the unmeasured disturbance effects of flows in or out of tanks three and four.

This model is a simple mass balance, assuming Bernoulli’s law for flow out of the orifice. The gamma values, γ_i , correspond to the the portion of the flow going into a upper tank from pump i . In [2], it is shown that inverse response in the modeled outputs will occur when $\gamma_1 + \gamma_2 < 1$. A modification introduced by the students in the class was the presence of a disturbance introduced by a submersible pump in the upper tanks. These disturbances effects are modeled as a constant leak into or out of the upper tanks.

5 Project Summaries

To illustrate the use of the Four Tank System in the graduate control course, the following projects are briefly described. It should be noted that each of the four elements (modeling, analysis, synthesis, and implementation) were performed by each student group. A more detailed theoretical treatment of the results can be found in [5].

5.1 Process Identification

Although the fundamental model described earlier is a reasonably accurate description of the system dynamics, many of the parameters are not available *a priori*, which requires the estimation of several model parameters. The tank areas A_i can be measured directly from the apparatus. Using tank drainage data, the cross sectional outlet areas a_i can also be determined. The steady-state operating point of $\nu_1 = 60\%$ and $\nu_2 = 60\%$ were used for subsequent results. The system valves were set such that the

operating point exhibits inverse response ($\gamma_1 + \gamma_2 < 1$). Time constants, T_i , for the linear system model were on the order of 40 seconds.

The students designed a suitable test input sequence to generate data for the estimation of the remaining parameters. In this case, they elected to identify the parameters of the original nonlinear model, requiring the solution of a nonlinear optimization problem. The problem was formulated to minimize the 2-norm of the difference between the nonlinear model and actual measurements, searching over four parameters. Using dynamic data from the experiment, the optimization routine found the optimal pump gains k_i and gamma values γ_i as depicted in Table 4. A similar routine was employed to model the characteristics of the disturbance introduced by the submersible pumps, k_{d_1} and k_{d_2} .

A critical step in any identification procedure is the validation of the model against novel data. The students were successful in validating the model that resulted from the previous optimization problem. They were able to capture the known inverse response in the system, and they also were able to compare the nonlinear model response to a linear approximation, which was subsequently used for analysis.

5.2 Acceptable Control Analysis

As mentioned earlier, one of the key insights derived from this course is the limitation to achievable closed-loop performance due to intrinsic system properties. Once the students had obtained the physical models of the system, they computed a linearized approximation at a steady state operating point and analyzed the controllability properties of the resulting linear system. The inputs and outputs of the system were appropriately scaled before the controllability analysis was carried out.

The first metric considered was the Relative Gain Array (RGA) as a function of frequency. For the system configuration employed in this study, the students found that the diagonal RGA elements were very near to 1 at low frequency, suggesting an easily decoupled system. However, as the frequency increased to the bandwidth region, the students discovered that the diagonal RGA values decreased significantly, indicating the importance of multivariable interactions in the bandwidth of interest. Such an insight is particularly valuable at the graduate control level to highlight the limited interpretation of the steady state RGA value.

Additional insight is derived from an analysis of the singular values of the system. More specifically, their ratio (the condition number), gives an indication of the sensitivity of the plant to uncertainty. The condition number at low frequencies was small, between 1 and 3. However, it decreases with frequency, implying that the plant is more sensitive to uncertainty at steady state than at higher frequencies. In addition, the low frequency minimum singular value is above 1. This means that adequate control action should be possible; the input moves will be able to move the outputs a sufficient amount to track setpoints. The minimum singular value of the plant is greater than 1 up to the frequency of $\omega = 0.007 \frac{rad}{sec}$. This indicates a potential constraint on the controller bandwidth because of high frequency input saturation.

Another quantity of interest in control systems in general, and the Four Tank System in particular, is the location and direction of multivariable process zeros. For the operating conditions in this study, the multivariable zeros are found to be at -0.0791 and $0.0285 \frac{rad}{sec}$. The input zero direction corresponding to the Right-Half-Plane (RHP) zero is $[-0.715, 0.699]^T$, and the output direction is $[0.718, -0.696]^T$. From these directions, one can see that forcing one pump up while the other is forced down causes the system to display inverse response. The presence of the RHP-zero could also be seen in a plot of the RGA, in that the elements of the RGA change sign from frequency $\omega = 0$ to frequency $\omega = \infty$. The lesson that the students will take away from this analysis is that the RHP-zero also limits the controller bandwidth.

5.3 Uncertainty Characterization

For completeness in the overall project description, the topic of uncertainty characterization is briefly mentioned. The technical details can be found in [5]. The emphasis was on bounding the uncertainty between the approximate linear model that was used for control synthesis and the actual physical system with parametric uncertainty. A multiplicative input uncertainty structure was determined by the students to adequately represent the actual non-ideal behavior of the system. After subjecting the linear model to parametric variations ($\pm 10\%$ in γ_i and k_i), approximate bounds were determined from the corresponding frequency plots of the multiplicative uncertainty. This uncertainty characterization is central to the robust controller design task which is described below.

5.4 Robust Controller Design and Implementation

The students employed robust control theory to initially design a H_∞ controller following the procedures detailed in [1]. Using a D-K iteration procedure, a robust 12th order controller with a structured singular value, μ , less than one was obtained. The controller was implemented in the real system. As one might expect with a physical system, the simulations did not precisely match reality. The nonidealities of the pumps, level sensors, and head losses in the piping all contributed to these discrepancies. Other unmodeled phenomena witnessed by the students include the formation of vortices in the upper water tanks above the drainage holes and spontaneous triggering of the level alarms due to condensation. Despite the lack of perfect agreement between theory and practice, the students were able to generate controllers with robust performance guarantees.

Representative results demonstrating the disturbance rejection capability and setpoint tracking performance of one controller design is shown in Figures 7 and 8, respectively. This controller was designed for disturbance rejection, which results in excessive input moves for setpoint moves. A robustly performing setpoint tracking controller was also implemented. This design requires an additional setpoint filter in order to satisfy the constraints on the input moves.

The students clearly mastered a moderately complex control problem.

6 Summary

We have described the use of an elegant experiment for reinforcing the theoretical content of a typical graduate control course. Although the overall physics of the process are not very sophisticated, we have shown that the system exhibits rich behavior which can be used to exercise principles in modeling, analysis, and advanced control design.

The use of a PC-based DCS coupled with MATLAB/Simulink was particularly effective in the implementation of the laboratory control process. The PC-based system was more flexible than traditional DCS systems, and the DDE interface facilitated a range of complex control designs that are appropriate for the graduate level.

Our ongoing efforts with this experiment include the use of the Four Tank System in a multidisciplinary control engineering laboratory. The course was first offered in the Spring of 1999 as a senior-level elective, and drew students from chemical, electrical, and mechanical engineering. We plan to report our experiences with this implementation in a future publication.

7 Acknowledgments

We would like to acknowledge the support of our former Dean, Stuart Cooper, who first encouraged us to create such a lab and provided the initial funding. The continuing support of our department Chair, Eric Kaler, and Dean, Andras Szeri are greatly appreciated. None of this work would have been possible without the expert craftsmanship of George Whitmyre, who constructed the Four Tank System. We would also like to acknowledge the additional graduate students who worked on the Four Tank System - Luis J. Puig and Radhakrishnan Mahadevan.

References

- [1] G. J. Balas, J. C. Doyle, K. Glover, A. Packard, and R. Smith. *μ -Analysis and Synthesis Toolbox User's Guide*. The Mathworks, Natick, MA, 1995.
- [2] K. H. Johansson and J. L. R. Nunes. A multivariable laboratory process with an adjustable zero. In *Proc. American Control Conf.*, 1998.
- [3] N. A. Kheir, K. J. Åström, D. Auslander, K. C. Cheok, G. F. Franklin, M. M. Masten, and M. Rabins. Control systems engineering education. *Automatica*, 51(8):147–166, 1995.
- [4] S. Skogestad and I. Postlethwaite. *Multivariable Feedback Control*. John Wiley & Sons, New York, NY, 1996.
- [5] R. Vadigepalli, E. P. Gatzke, and F. J. Doyle III. Robust H_∞ control of an experimental 4-tank system. *in preparation*, 1999.

Ed Gatzke received his B.S.ChE. from the Georgia Institute of Technology in 1995. After two years of graduate study at Purdue University, he moved to the University of Delaware Chemical Engineering Department for completion of his Ph.D. Ed has held internships with Teledyne Brown Engineering, Mead Paper, and Honeywell. His interests include: process control, optimization, and artificial intelligence.

Raj Vadigepalli received his B.Tech. in Chemical Engineering from the Indian Institute of Technology, Madras, India, in 1996, and began his Ph.D. research in chemical engineering at Purdue University, West Lafayette, IN, in the fall of 1996 under Prof. Francis J. Doyle III. In September 1997, he moved with professor Doyle to the University of Delaware to complete his doctoral degree. His research focus includes modeling and analysis of control mechanisms in biological systems and distributed hierarchical methods for control of large-scale process systems.

Edward S. Meadows is a postdoctoral fellow at the University of Delaware, working in the areas of modeling and control of polymerization reactors as part of a broader research program in optimization and control of chemical processes. Dr. Meadows received the Ph.D. degree from the University of Texas in 1994.

Frank Doyle received his B.S.E. from Princeton (1985), C.P.G.S. from Cambridge (1986), and Ph.D. from Caltech (1991), all in Chemical Engineering. After graduate school, he worked at DuPont as a Visiting Scientist in the Strategic Process Technology Group (1991-1992), then started as an Assistant Professor at Purdue University in 1992. He moved to the University of Delaware as an Associate Professor in the fall of 1997. His research interests are in the areas of process and biosystems analysis and control.

1	Study the system (plant) to be controlled and obtain initial information about the control objectives.
2	Model the system and simplify the model, if necessary.
3	Analyze the resulting model; determine its properties.
4	Decide which variables are to be controlled (controlled outputs).
5	Select the control configuration.
6	Decide on the type of controller to be used.
7	Decide on performance specifications, based on the overall control objectives.
8	Design a controller.
9	Analyze the resulting controlled system to see if the specifications are satisfied; and if they are not satisfied modify the specifications or the type of controller.
10	Simulate the resulting controlled system, either on a computer or pilot plant.
11	Repeat from step 2, if necessary.
12	Choose hardware and software and implement the controller.
13	Test and validate the control system, and tune the controller on-line, if necessary.

Table 1: Steps in control design

$$\begin{aligned}
\frac{dh_1}{dt} &= -\frac{a_1}{A_1}\sqrt{2gh_1} + \frac{a_3}{A_1}\sqrt{2gh_3} + \frac{\gamma_1 k_1}{A_1}\nu_1 \\
\frac{dh_2}{dt} &= -\frac{a_2}{A_2}\sqrt{2gh_2} + \frac{a_4}{A_2}\sqrt{2gh_4} + \frac{\gamma_2 k_2}{A_2}\nu_2 \\
\frac{dh_3}{dt} &= -\frac{a_3}{A_3}\sqrt{2gh_3} + \frac{(1-\gamma_2)k_2}{A_3}\nu_2 - \frac{k_{d1}d_1}{A_3} \\
\frac{dh_4}{dt} &= -\frac{a_4}{A_4}\sqrt{2gh_4} + \frac{(1-\gamma_1)k_1}{A_4}\nu_1 - \frac{k_{d2}d_2}{A_4}
\end{aligned}$$

Table 2: Nonlinear model equations

$$\frac{dx}{dt} = \begin{bmatrix} -\frac{1}{T_1} & 0 & 0 & 0 \\ 0 & -\frac{1}{T_2} & 0 & 0 \\ 0 & 0 & -\frac{1}{T_3} & 0 \\ 0 & 0 & 0 & -\frac{1}{T_4} \end{bmatrix} x + \begin{bmatrix} \frac{\gamma_1 k_1}{A_1} & 0 \\ 0 & \frac{\gamma_2 k_2}{A_2} \\ 0 & \frac{(1-\gamma_2)k_2}{A_3} \\ \frac{(1-\gamma_1)k_1}{A_4} & 0 \end{bmatrix} u + \begin{bmatrix} 0 & 0 \\ 0 & 0 \\ -\frac{k_{d1}}{A_3} & 0 \\ 0 & -\frac{k_{d2}}{A_4} \end{bmatrix} d$$

$$T_i = \frac{A_i}{a_i} \sqrt{\frac{2h_i(0)}{g}}$$

Table 3: Linearized model equations

a_1, a_2	2.3 cm^2	k_1	$5.51 \text{ cm}^3/s$
a_3, a_4	2.3 cm^2	k_2	$6.58 \text{ cm}^3/s$
A_1, A_2, A_3, A_4	730 cm^2	g	$981 \frac{\text{cm}}{\text{s}^2}$
$\nu_1(0)$	60%	γ_1	0.333
$\nu_2(0)$	60%	γ_2	0.307
T_1	53.8 sec	$h_1(0)$	14.1 cm
T_2	48.0 sec	$h_2(0)$	11.2 cm
T_3	38.5 sec	$h_3(0)$	7.2 cm
T_4	31.1 sec	$h_4(0)$	4.7 cm

Table 4: Model parameters

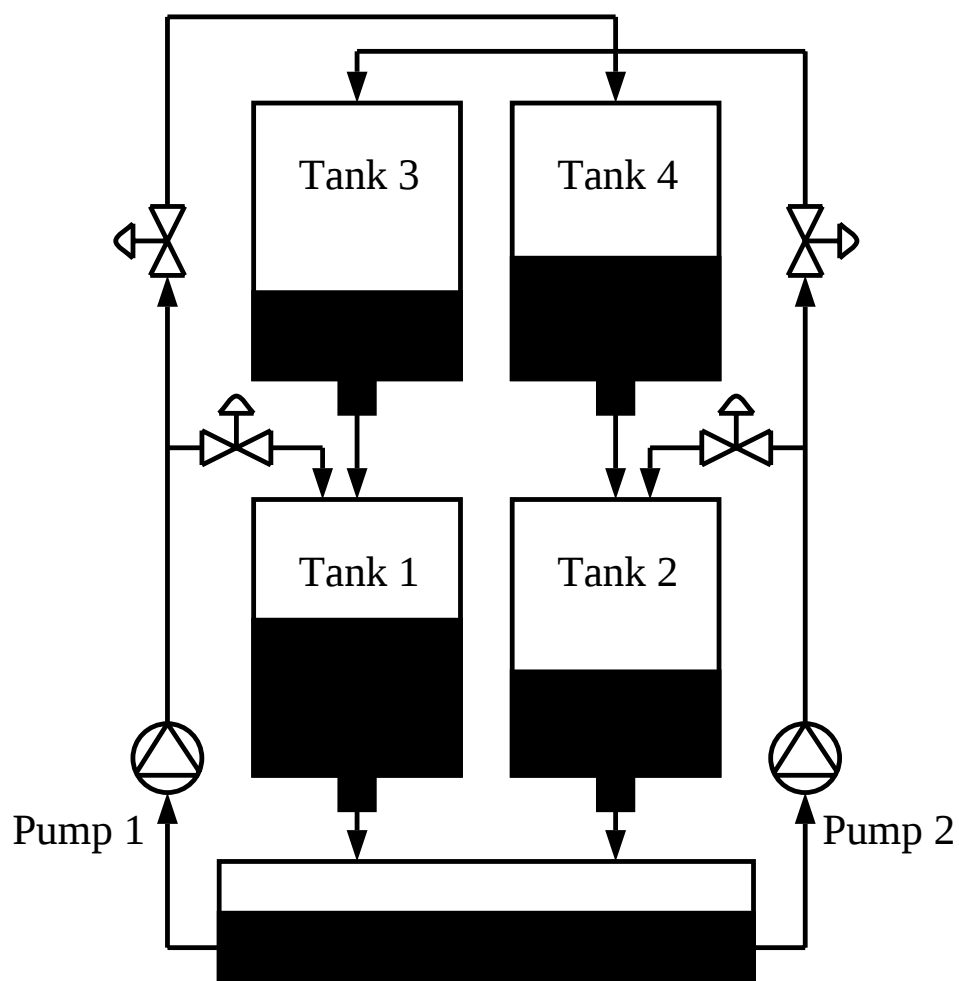


Figure 1: Schematic of the four tank system



Figure 2: Laboratory apparatus

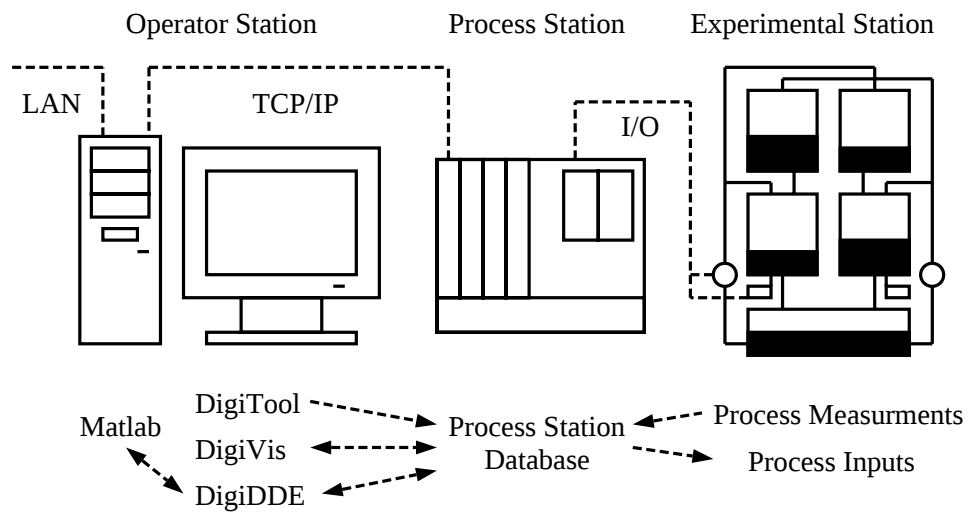


Figure 3: Schematic of the control system

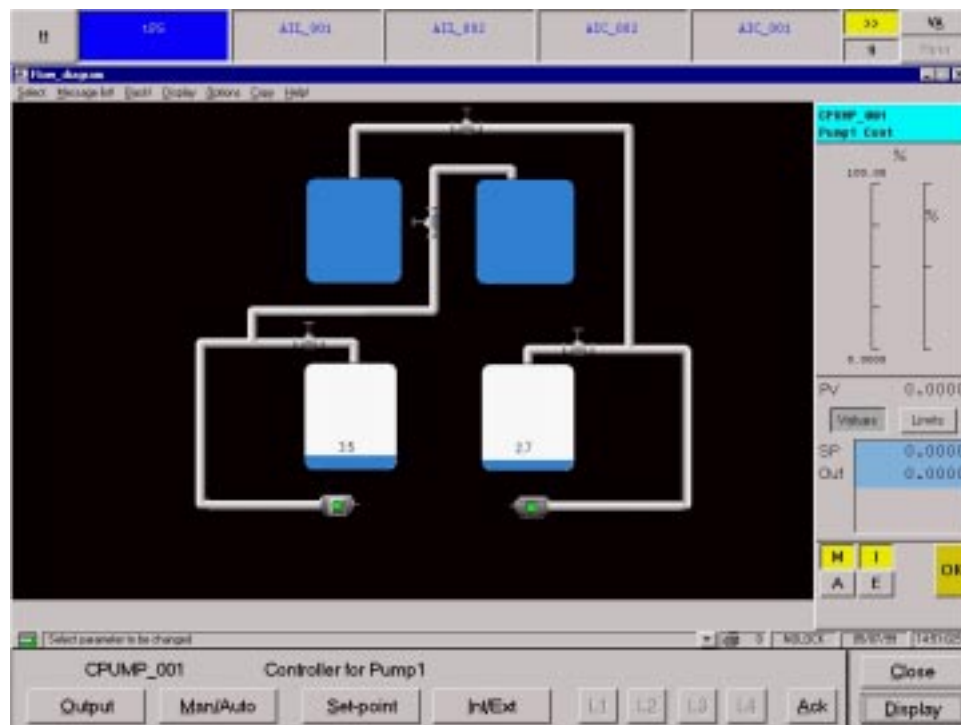


Figure 4: Screenshot of Freelance four tank schematic

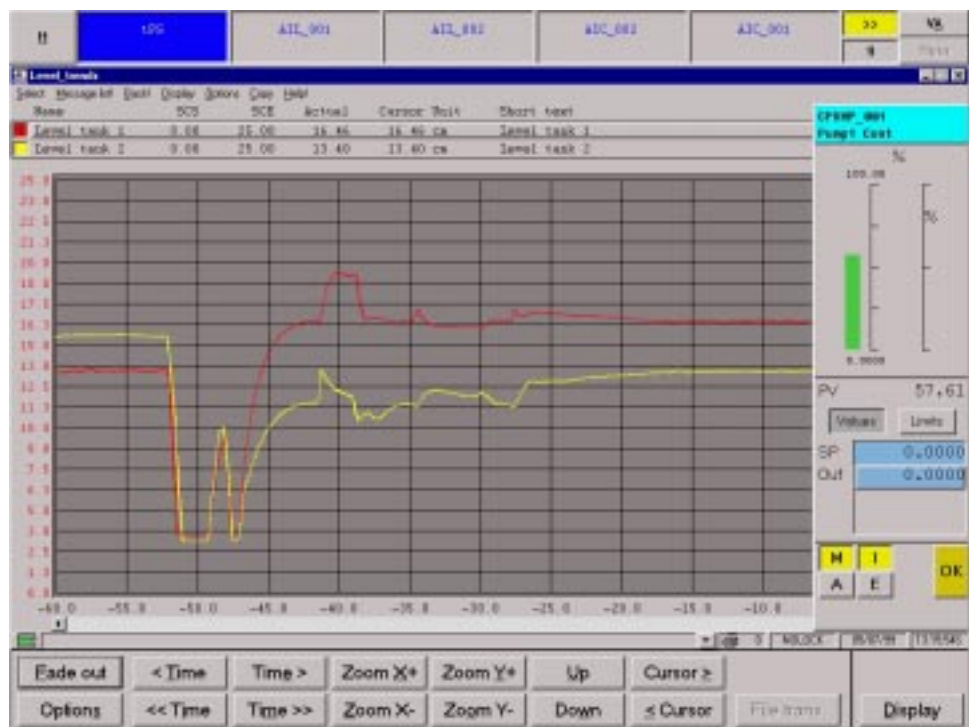


Figure 5: Screenshot of Freelance tank level trends

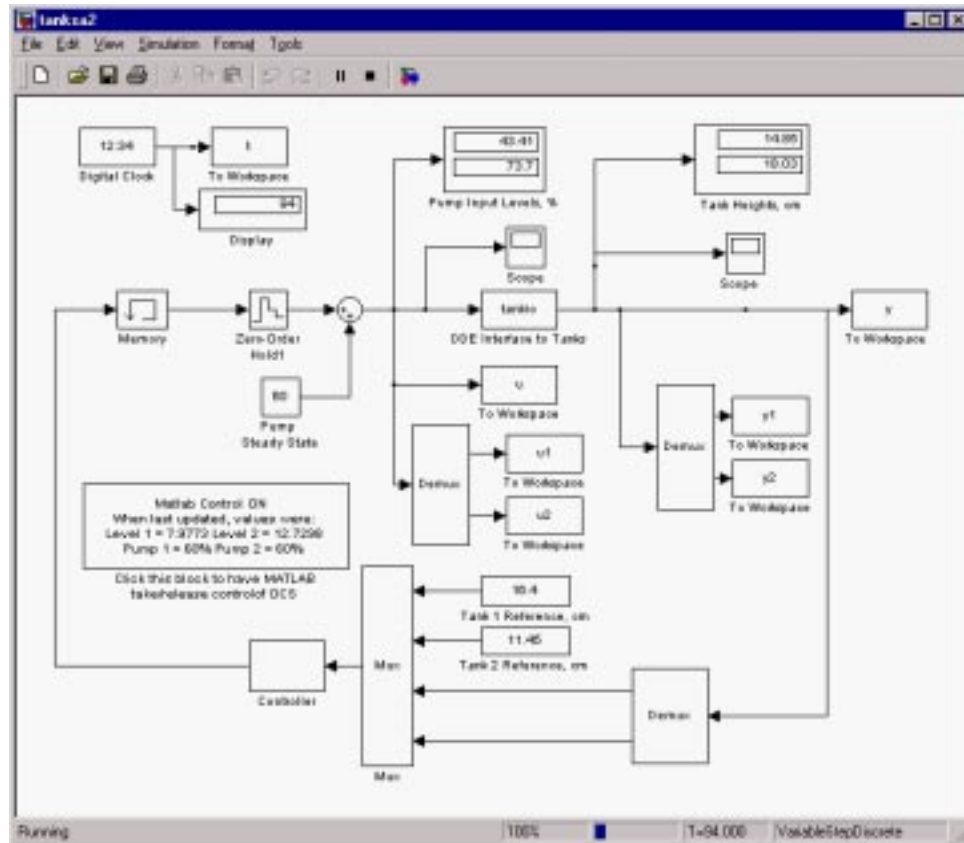


Figure 6: Screenshot of the Matlab Interface

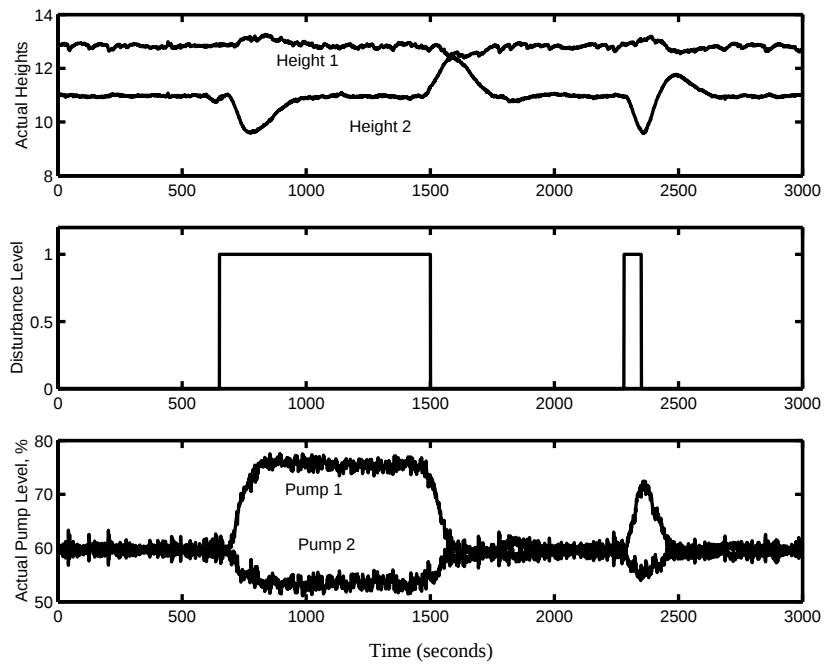


Figure 7: Disturbance rejection using robust controller

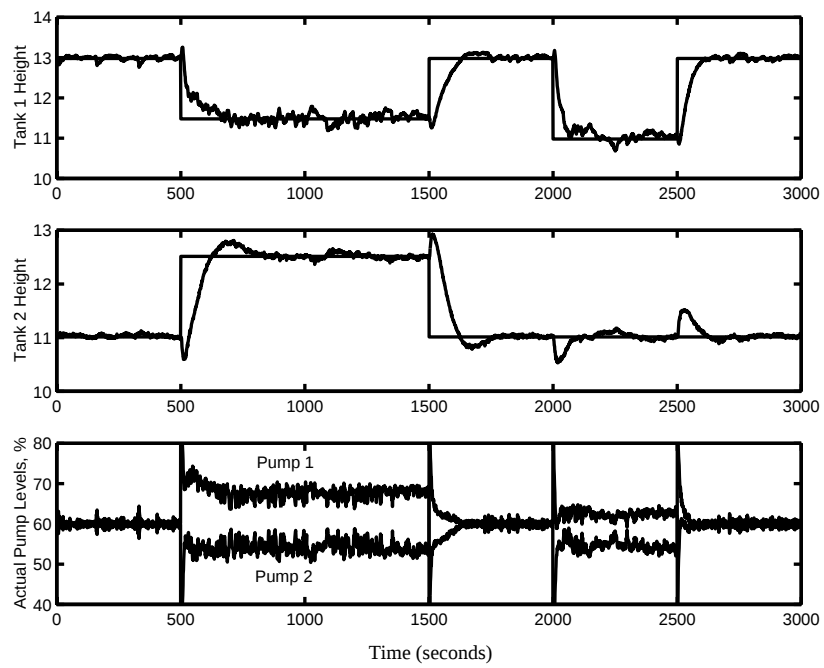


Figure 8: Reference tracking using robust controller

Figure Captions:

Figure 1: Schematic of the four tank system

Figure 2: Laboratory apparatus

Figure 3: Schematic of the control system

Figure 4: Screenshot of Freelance four tank schematic

Figure 5: Screenshot of Freelance tank level trends

Figure 6: Screenshot of the Matlab Interface

Figure 7: Disturbance rejection using robust controller

Figure 8: Reference tracking using robust controller